Installation, Operation & Maintenance



△ A.R.I. NR-010 VB

SPRING-LOADED VACUUM BREAKER

The following is a step-by-step narrated description of A.R.I. NR-010 VB Spring-Loaded Vacuum Breaker installation, operation and maintenance processes.

A.R.I. NR-010 VB is a composite material, normally closed, full-bore, spring-loaded Vacuum Breaker. It is designed to seal "drip-tight" and to open fully at minimal differential pressure, allowing intake of air into the pipeline or system when vacuum conditions occur; thus, protecting the pipeline.

Negative pressure (vacuum) conditions are caused by sudden shutoff of pumps, pipe ruptures or rapid draining of the pipeline.





TABLE OF CONTENTS

1.	SAFETY INSTRUCTIONS	3
2.	INSTALLATION	6
3.	OPERATION	8
	TROUBLESHOOTING	
	PERIODIC MAINTENANCE	
	5.1. Maintenance – See drawings on Section 5 of this document	10
	ASSEMBLY BOM TABLES AND DRAWINGS	
AS:	SEMBLY BOM NR-010 VB 6". 8".10" With D-040	12

Disclaimer

This document is an Installation, Operation and Maintenance (IOM) manual for Aquestia Ltd. The information enclosed herein contains restricted, privileged, proprietary and confidential information, intended only for usage by authorized Aquestia technicians. If you are not a qualified technician, you must not take any action in reliance upon this document, unless otherwise permitted in writing by Aquestia

Aquestia has made every effort to ensure that this document is accurate; Aquestia disclaims liability for any inaccuracies or omissions that may have occurred.

All the procedures, drawings, pictures and/or any other information provided in this document are presented as general information only; they can be altered, removed or changed without Aquestia's prior written approval. Aquestia makes no commitment to update or keep the information in this document current and/or up-to- date, and reserves the right to make improvements, alterations and/or modifications to this document and/or to the products described in this document, at any time without providing any notice with respect thereto. Nothing in this Disclaimer derogates in any way whatsoever from the confidential nature of any document enclosed hereto, including for avoidance of doubt, any mistake or clerical error or other error. None of the procedures provided in this Disclaimer and/or in any document enclosed hereto may be used in any form or by any means without the prior written consent from Aquestia If you received this Disclaimer and/or in any document enclosed hereto is not intended for you, please notify Aquestia in writing immediately.

Aquestia assumes that all users understand the risks involved within this Disclaimer and/or in any document enclosed hereto. Aquestia accepts/assumes no liability whatsoever, whether caused by: accessing and/or relying upon this Disclaimer and/or in any document enclosed hereto including without limitation any links, procedures or materials.

shall NOT assume any liability for any costs, direct or indirect, including loss of income, loss of profits and/or goodwill, legal actions and/or damages of any kind whatsoever including any, damages accidents, equipment damage or bodily injury resulting from and/or related to any of the following:

- product has not been duly installed and thereafter maintained in strict compliance with its designated Maintenance Instructions and/or any other installation and operation manuals provided by Aquestia for the product and/or applicable ordinances and/or codes;
- Repairs made in and to the products by personnel not authorized by Aquestia
- Maintenance or repairs using parts or components other than those specified by Aquestia and in their original condition.
- Operating the products in ways other than the operating procedures described in the manuals provided by Aquestia, or resulting from not following the cautionary remarks and warnings in the product manual.
- Improper storage, workplace conditions and environmental conditions which do not conform to those stated in the Product manual.
- Fires, earthquakes, floods, lightning, natural disasters, or acts of God.

Aquestia does not warrant and hereby disclaims any express or implied warranties that the product will work properly in environments and applications other than its original design purpose, and makes no warranty and representation, either implied or expressed, with respect to the quality, performance, merchantability, or fitness for any other particular purpose.

Except as provided herein and to the full extent permitted by law, Aquestia shall not be responsible and/or liable for direct, special, incidental or consequential damages or loss resulting from any breach of the above or under any other legal theory.

This document does not replace any certified drawing, procedure or information provided by Aquestia in reference to a specific customer, site or project. All rights reserved.



1. SAFETY INSTRUCTIONS

General

- 1. Aquestia products always operate as components in a larger system. It is essential for the system designers, installers, operators and maintenance personnel to comply with all the relevant safety standards.
- 2. Installation, operation or maintenance of the product should be done only by qualified workers, technicians and/or contractors using only good engineering practices, complying with and observing all conventional safety instructions in order to minimize risk and/or danger and/or hazard to workers, the public or to property in the vicinity in accordance with all relevant local standards.
- 3. Extra safety considerations should be taken with hot and hazardous liquids or in hazardous environments' applications to avoid bodily/physical harm and damage to public or private property.
- 4. All individuals installing operating and/or handling the products including all workers should at all times adhere with the occupational safety and health (OSH) instructions and wear safety helmets, goggles, gloves, and any other personal safety equipment required by the local standards and regulations.
- 5. Use only appropriate standard tools and equipment operated by qualified operators when installing, operating and maintaining the product.
- 6. Prior to installation, operation, maintenance or any other type of action carried out on the product, read carefully the safety, installation and operation instructions of the product.

7. Please note:

- Pressurized fluid and/or gas may be discharged from the product without prior warning. Make sure that the product's outlet port is not directed toward electrical elements (pumps) or people.
- The pressurized fluid and/or gas that can be discharged from the product may create high noise levels. Take this into consideration when installing the product in areas sensitive to noise.
- 8. Always open and close valves slowly and gradually.
- 9. Please note that the maximum working pressure indicated at the product's specifications table doesn't include pressure changes caused by water hammer and pressure surge effects. Use the product only according to its designated pressure rate specifications.
- 10. Use the product only for its intended use as designed by Aquestia. Any misuse of the product may lead to undesired damages and may affect your warranty coverage. Please consult with A.R.I. prior to any non-regular use of this product and make no change or modification to the product without a prior written consent to be provided by Aquestia at Aquestia's sole discretion.
- 11. Please note that Aquestia shall <u>NOT</u> assume any liability with respect to any damage losses and/or expenses caused to any person and/or property whatsoever unless the product has been duly installed and thereafter maintained in strict compliance with its designated maintenance Instructions and/or any other installation and operation manuals provided by A.R.I. for the product and/or applicable ordinances and/or codes.

Handling

- 1. Shipping and handling the product must be done in a safe and stable manner and in accordance with the relevant standards and regulations.
- 2. Storage should be in the original delivery crates or cases. Storage should be off the ground in a clean, dry indoor area.
- 3. For lifting and positioning the product, use only approved lifting equipment operated by authorized employees and contractors.
- 4. Prior to the installation visually verify that the product was not damaged during shipment to the installation site.



Installation

- 1. Install the product according to the detailed Installation Instructions provided with it by Aquestia and according to the description given in this manual.
- 2. The user should install a manual Isolation Valve under the product's inlet port.
- 3. In all installation sites the user should enable good visibility and verify that the work and auxiliary equipment used are done in accordance with the relevant local authorized standards. Extra safety considerations should be taken on hazardous environment sites.
- 4. Check and re-tighten the bolts connecting the product to the pipeline during commissioning and before operating the product for the first time.

Commissioning and operation

- 1. Read carefully the operation instructions prior to any attempt to operate the product.
- 2. Observe the safety stickers on the product and never perform any operation contradicting the instructions given.
- 3. In order to achieve maximum performance and smooth operation of the product it is crucial to perform the startup and first operation procedures exactly as described in this manual.
- 4. In cases where formal commissioning procedure is required it should be done by an authorized Aquestia technician prior to the first operation of the product.

Maintenance

Before any maintenance or non-regular operation please read the following:

- 1. Servicing the product should be done only by qualified technicians for this type of work.
- 2. Make sure that you know the exact type of the system's fluid. Act accordingly and comply with all the relevant standards and regulations set for handling this type of fluid.
- 3. Before disconnecting the product from the system and before releasing the residual pressure do **NOT**:
 - o loosen or unscrew the product bolts;
 - remove any protection cover;
 - o open any service port.
- 4. Before any maintenance or non-regular operation shut off the Isolation valve and release the residual pressure:
 - A. For air valves with pressure release outlet, slowly open the pressure release plug or the ball valve and make sure that all pressure is released. Please note that some air release valves, especially the waste water models, may contain significant volume of compressed gas with accumulated energy!
 - B. For air valves without a pressure release outlet, slowly unscrew the flange bolts until all the pressure is released from the valve.
- 5. Make sure the air valve is empty of all liquid prior to commencing maintenance.
- 6. Remove the product from the line only after ensuring that internal pressure has been released.
- 7. Place warning signs around the work area as required by the local standards and procedures.
- 8. Inspect the product's safety stickers and replace any damaged or faded sticker.
- 9. Manual cleaning of the product and/or its components using high water pressure or steam should be performed in accordance with its specific cleaning instructions, the local standards and regulations and without endangering the operator or the vicinity
- 10. Manual cleaning of product and/or its components using acid or other chemical agents should be performed in accordance with the specific cleaning instructions, the relevant safety instructions for using that chemical as given by its supplier, the local standards and regulations and without endangering the operator or his vicinity.
- 11. For products used in potable water systems if it is required to disinfect the product, do so according to the local water authority standards and regulations before putting the product into service.



Before returning to regular operation

- 1. Re-assemble any protection covers or protection mechanisms removed during service or maintenance operations.
- 2. Make sure that all the tools, ladders, lifting devices, etc. used during the maintenance procedures are taken away from the product area and stored.
- 3. Remove grease and fat material residues in order to avoid slipping.
- 4. In order to return the product to regular operation, follow the First Start-up Operation instructions as detailed in your user manual.




2. INSTALLATION

<u>Important</u>: Before performing any work on the air valve make sure that all workers on site are familiar with the safety instructions and the relevant local and general safety instructions and work regulations.


2.1. Installation Recommendations



Single Vacuum Breaker on an Isolating Valve at 45° to Air Valve

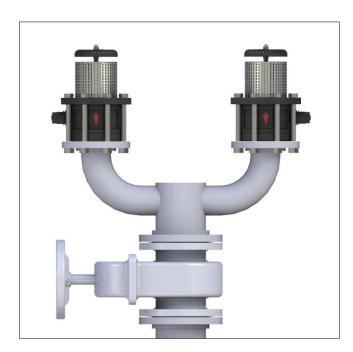

Two Vacuum Breakers on a shared Isolating Valve.

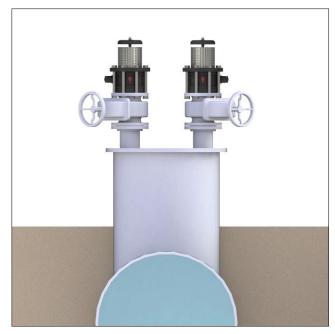

Two Vacuum Breakers on an Air Trap with separate Isolating Valves. The Isolating Valves at 45° to Air Valve.



Underground Installations

In case of installation in an underground chamber, a vent pipe must be installed with a diameter equal to or greater than the Vacuum Breaker. The vent outlet must have a mesh screen to prevent entry of animals or objects.



2.2. Conventions and Measurements


This paragraph presents and explains the terms and measurements used for the Installation process.

D = Diameter of pipeline

d = diameter of riser

H = Height of riser on the pipeline (Measured from crown of pipeline)

- For pipelines up to 12" (300mm) in diameter (D), the Air Trap diameter (d) should be the same as the pipeline diameter.
- For larger pipelines of up to 60" (1500mm) in diameter (D), the Air Trap diameter (d) should be 60% of the pipeline diameter.
- For larger than 60" (1500mm) pipelines (D), the Air Trap diameter (d) should be 35% of the pipeline diameter.
- The Air Trap length (H) should allow easy access to the air valve from below and should be at least 6" (150mm).

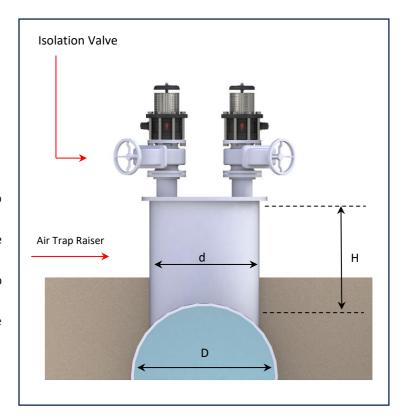



2.3. Installation Instructions

- 1. Flush the system before installing the vacuum breaker to avoid any debris or sharp objects getting into it.
- 2. Carefully remove the vacuum breaker from the shipping package. Unload it carefully to a sturdy level surface taking care not to drop it.
- 3. Install an isolating valve below the vacuum breaker.
- 4. The NR-010 VB should be installed vertically on a riser on the crown of the pipeline. The riser diameter must be of an equal or greater diameter than the vacuum breaker.
- 5. NR-010 VB are installed in between flanges, make sure the isolation valve is not interfering with the check valve's disc full movement.

3. OPERATION

The NR-010 VB is designed to prevent vacuum conditions from occurring in pipelines. After a power failure or rapid draining of the system, a vacuum condition often occurs in a pipeline. It is designed to seal "drip-tight" and to open fully at minimal differential pressure, allowing intake of air into the pipeline or system when vacuum conditions occur, thus, protecting the pipeline.

4. TROUBLESHOOTING

Symptom	Possible Causes	Solution
The disc doesn't close	Interference between the disc motion and an adjacent shut-off valve (butterfly).	Separate the two devices, far enough, to avoid any physical contact between the NR-010 disc and the shut-off valve.
	Body deformation due to over tightening of the positioning bolts.	Check the tightening-moment of the retaining bolts to a reasoning level, allowing sealing at the flanges.
	The spring is clogged or not fully seated in its designated place.	Check the spring, correct or replace it.
Swelling of the Rubber seal disc	In many cases, the swelling is caused by the presence of dissolved Chlorine in the water near the Chlorinator in swimming pools or treatment stations.	The use of NR-010 in water with more than 4-6 ppm dissolved chlorine is not recommended



5. PERIODIC MAINTENANCE

Please note that the periodic maintenance of the vacuum breaker is an integral part of the proper pipeline maintenance regime; it should be maintained at least once a year in accordance with the quality and composition of the fluid in the system.

<u>Important:</u> Before doing any work on the vacuum breaker, make sure that all workers on site are familiar with the Safety Instructions section of this document and with all the relevant local and general safety instructions, standards and work regulations.



5.1. Maintenance – See drawings on Section 5 of this document

Disassembly.

- Shut the isolating valve located on the riser under the vacuum breaker.
- Carefully release the pressure and drain the vacuum breaker.
- Important: Discard liquid to comply with local regulation.
- Unscrew and remove all Bolts, Washers, and Nuts, to remove the NR-010 VB from the riser.
- Check the integrity of the seals and the disc seal, remove and replace if necessary.
- Check the flap free movement.
- Models combined with D-040 air valve, please see D-040 IOM.

Reassembly.

All parts must be clean before reassembly.

- 1. Reassembly the NR-010 VB in reverse order.
- 2. Re-open the isolating valve on the NR-010 VB inlet.
- 3. Recharge the pipeline and check for leaks.



6. ASSEMBLY BOM TABLES AND DRAWINGS

No.	Part	
1	Cover Assembly	
1a	Domed Nut	
1b	Cover	
1c	Washer	
1d	Nut	
2	Flange	
3	Strainer Assembly	
3a	Bolt	
3b	Strainer Ring	
3c	Strainer	$\longleftarrow (2)$
4	Body Assembly	
4a	Body	
4b	Spring Housing	
4c	Spring	T T
4d	O-ring	
4e	Spring Cover	
5	Flap Assembly	
5a	Disk Seal	
5b	Flap	(3)
5c	Flap Lock Right	
5d	Pan Head Philips	
5e	Flap Lock Left	
6	Spacer Assembly	
6a	Spacer Seal	
6b	Spacer	
6c	Body Seal	



ASSEMBLY BOM NR-010 VB 6", 8",10" With D-040

No.	Part
1	Cover Assembly
1a	Domed Nut
1b	Cover
1c	Washer
1d	Nut
2	Flange
3	Strainer Assembly
3a	Bolt
3b	Strainer Ring
3c	Strainer
4	Body Assembly
4a	Body
4b	O-ring
4c	Threaded Connector
4d	Threaded Bushing
4e	Elbow
4f	D-040
5	Flap Assembly
5a	Disk Seal
5b	Flap
5c	Flap Lock Right
5d	Pan Head Philips
5e	Flap Lock Left
6	Spacer Assembly
6a	Spacer Seal
6b	Spacer
6c	Body Seal

